

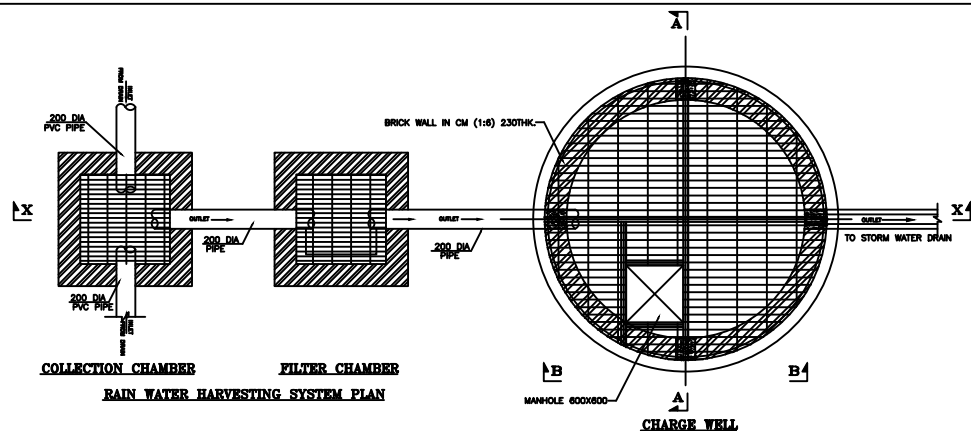




- LEGENDS:**
- FENCE
 - DRAIN
 - WATER CATCH PIT
 - DIRECTION OF SWITCHYARD SLOPE
 - DIRECTION OF DRAIN & PIPE SLOPE
 - V - WIDTH OF DRAIN
 - IL - INVERT LEVEL
 - FGL - FINISHED GROUND LEVEL
 - RC - ROAD CROSSING



GENERAL NOTES:

- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED.
- FGL DENOTES FINISHED GROUND LEVEL (BOTTOM OF GROUND)
- ALL BRICK WORKS SHALL BE OF FIRST CLASS BRICK IN CM 1:1.5.
- ALL LEAN CONC. SHALL BE MINIMUM 75MM THK WITH CC 1:3:6
- ALL STRUCTURAL STEEL SHALL CONFORM TO IS 2062 MIN. YIELD STRENGTH OF 250 N/Sqmm.
- ALL WELDS SHALL BE 6MM THICK CONTINUOUS FILLET WELD.
- MINOR ADJUSTMENTS MAY BE DONE AT SITE IN CONSULTATION WITH ENGINEER IN-CHARGE.
- THE SOIL AT SITE SHOULD BE WELL COMPACTED UP TO 95% PROCTOR DENSITY.
- ALL WRITTEN DIMENSIONS SHALL BE FOLLOWED.
- ISMC BEAM SHALL BE PAINTED WITH 2 COATS OF ZINC CHROMATE PRIMER AND 2 COATS OF ENAMEL PAINT.
- GRATING SHALL BE OF SS/GI GRADE.

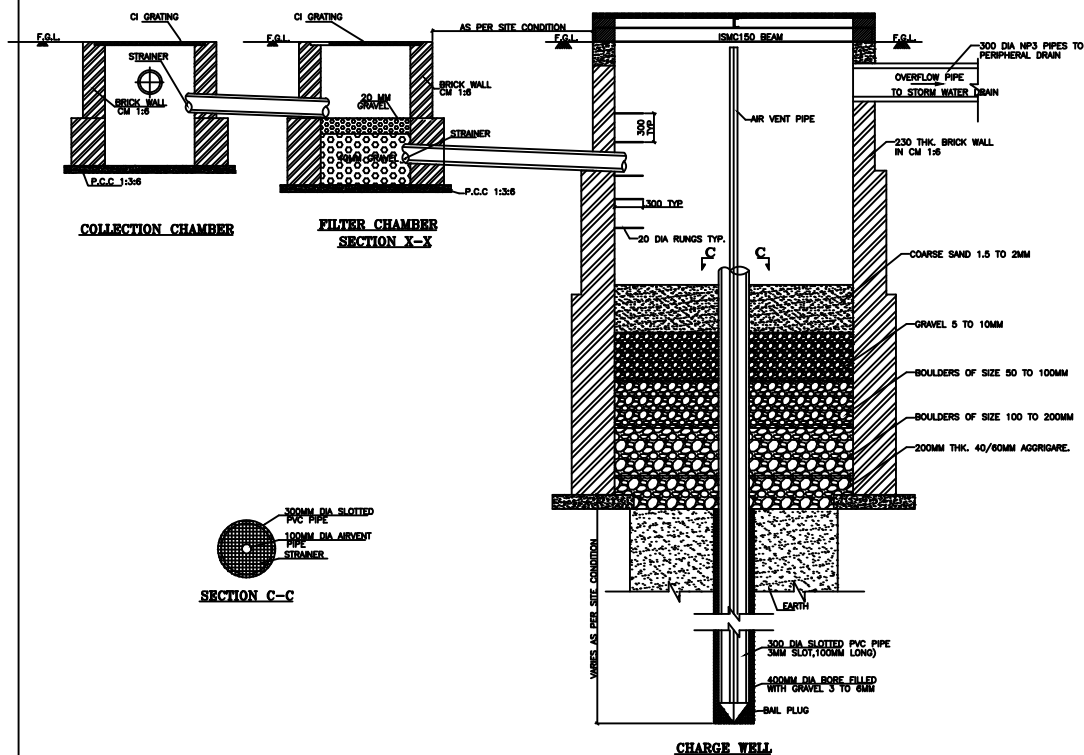

CLIENT	 ASSAM ELECTRICITY GRID CORP.LTD. BIJULI BHAWAN, GUWAHATI, ASSAM
PROJECT	
NOA NO.	
CONTRACTOR	
TITLE	Details of Rain Water Harvesting system
DRAWING NO.	
SCALE:	1:20
SHEET NO:	3 OF 3