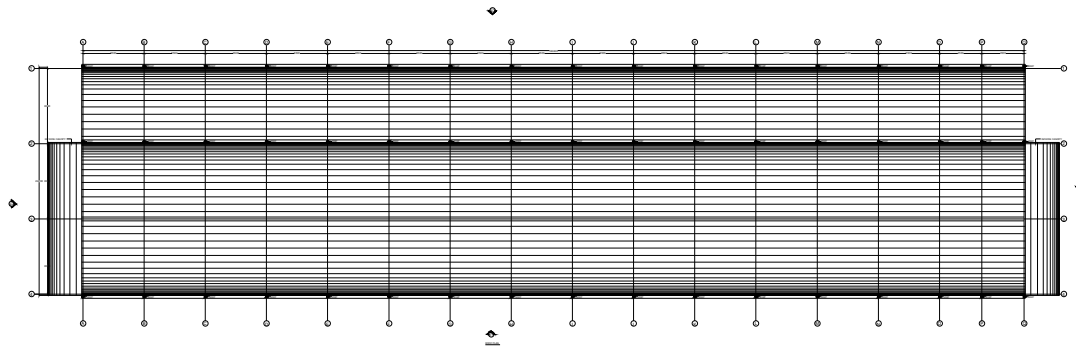
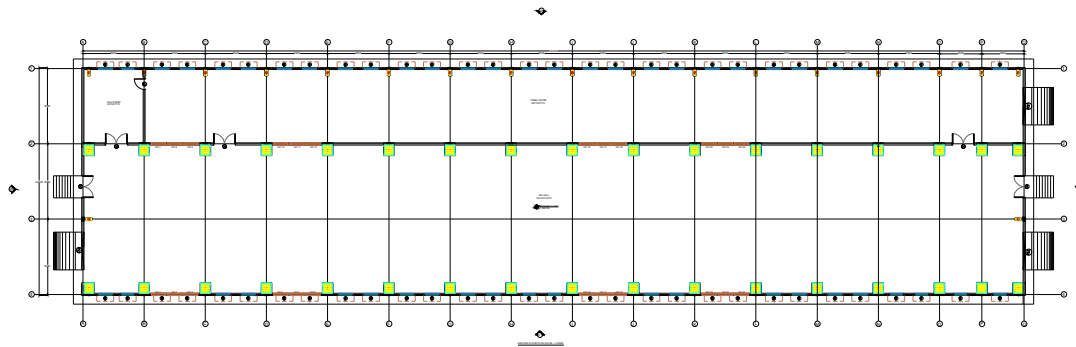


- NOTES:-
1. ALL DIMENSIONS ARE IN MM.
 2. FINAL DRAWING SHALL BE SUBMITTED BEFORE EXECUTION.
 3. THE MINIMUM HEIGHT OF ROLLING SHUTTER AT GIS PART SHALL BE 6.5 M.

DATE:  ARAM ELECTRICITY AND CONSULTING ENGINEERING

TITLE: 400kV GIS HALL LAYOUT

DRAWING NO: DRAWING FOR TENDER PURPOSE ONLY

SCALE: N/A SHEET NO: 1 OF 1