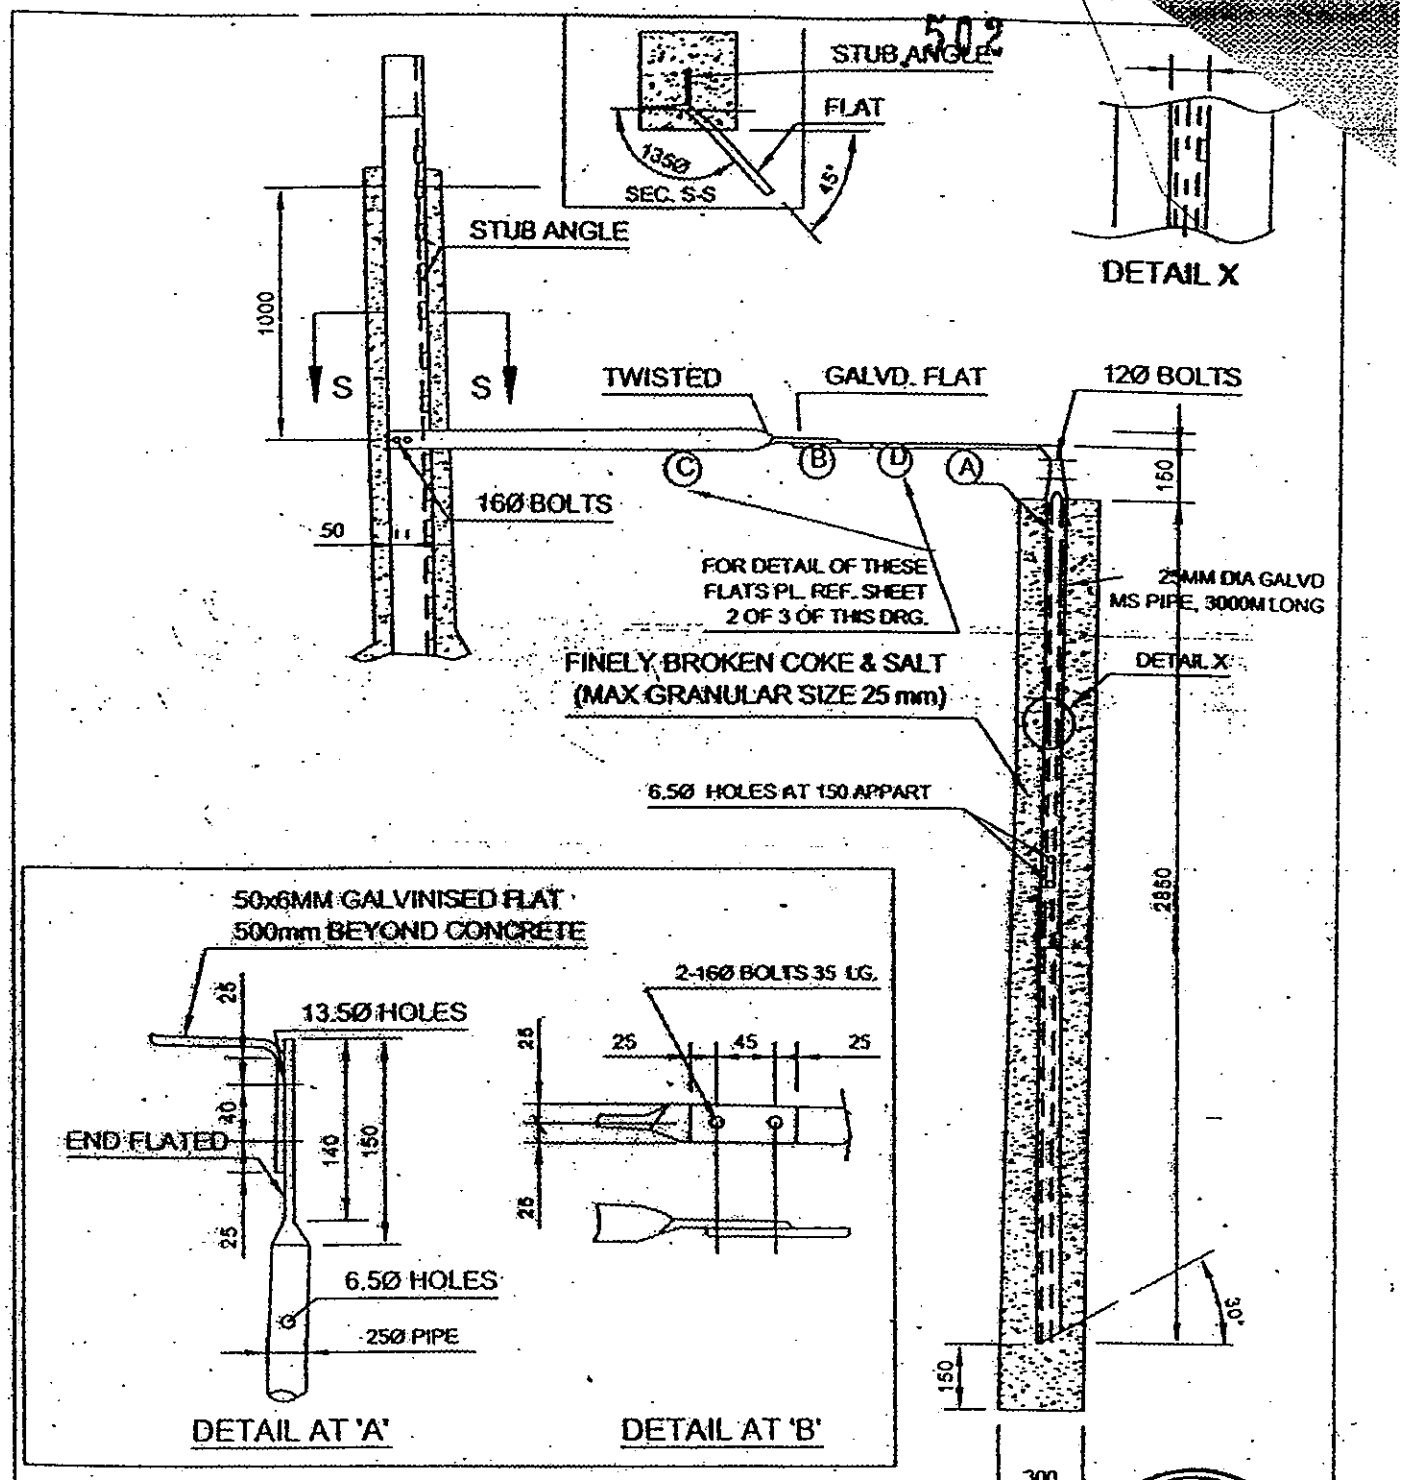

NOTES

1 : ALL DIM. ARE IN MM
2 : STRIP IS TO BE PROVIDED ON ONE LEG OF EACH TOWER
3 : STRIP WITH PIPE EARTH ARRANGMENT IS TO BE PROVIDED ON ONLY ONE LEG FOR THE LOCATION WHERE TOWER FOOTING RESISTANCE IS MORE THAN 10 OHMS
4 : 17.5 MM Ø HOLES SUITABLE FOR 16MM BOLTS FOR EARTHING DEVICES
5 : FOR COUNTER POISE EARTHING STRIP 'C' SHALL BE CONNECTED WITH COUNTER POISE WIRE THROUGH 'A' LUG

FOR BID PURPOSE ONLY

POWER GRID CORP. OF INDIA LTD.	
PROJECT	400KV TRANSMISSION SYSTEM
TITLE	DETAILS OF PIPE TYPE EARTHING
DRG. NO.	TL/400KV/006 (SHEET 1/3)
REV	0