


Pile foundation for DC 220 kV tower upto +9

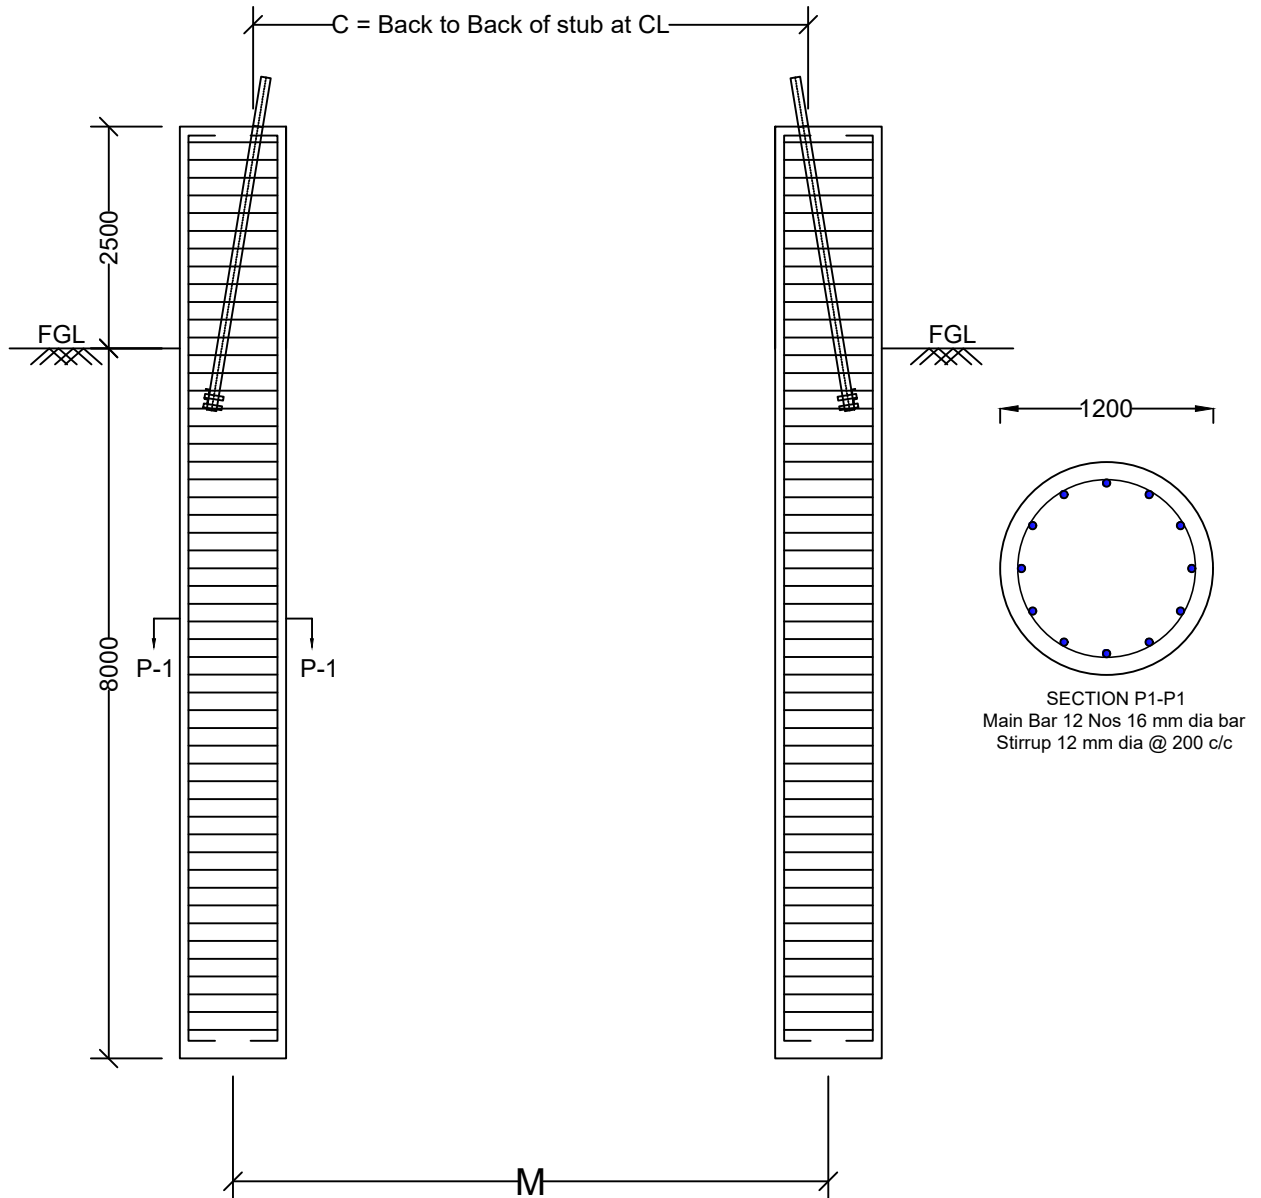

Note: C and M as per Stub Setting Template

- 1) DRAWING NOT TO SCALE
- 2) GRADE OF CONCRETE - M25
- 3) LAITANCE CONCRETE SHALL BE REMOVED ASPERIS CODE OR SITE REQUIREMENT WHICHEVER IS HIGHER
- 4) GRADE OF STEEL - Fe500
- 5) 6 MM THICK LINER FROM GL TO THROUGH OUT THE LENGTH
- 6) GROUND LEVEL WILL BE AS PER SITE CONDITION
- 7) STUB SETTING WILL BE AS PER STUB SETTING TEMPLATE DRAWING