


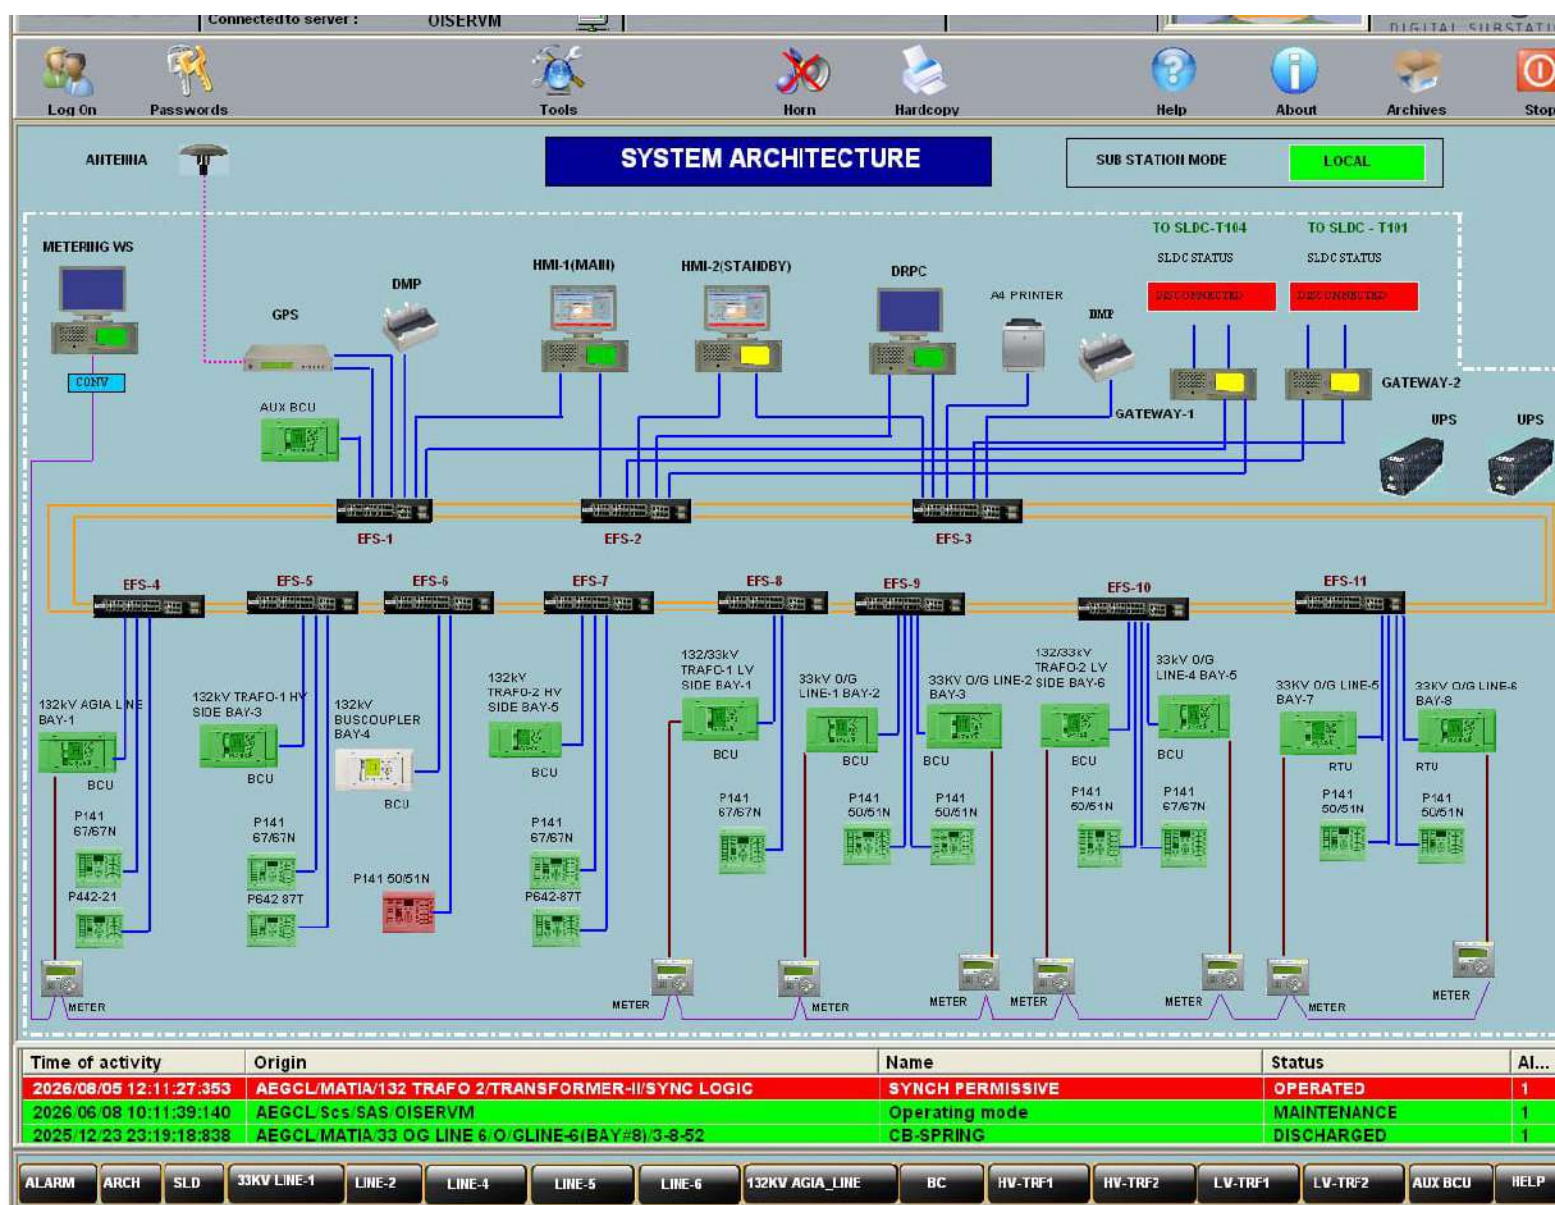

Existing Bay Details of 132KV Matia GSS						
Existing SCADA Details (MAKE AND Version): ALSTOM, DS Agile 5.3.4.2 DB Version: 2.62.7						
No.of Ethernet Switch with details: 11, Make : SIEMENS, RUGGEDCOM RS900NC, RS900NC-HI-D-MT-XX-XX, 6GK60900AS130BA0-ZA08+B00+X01						
Sl No	Name of feeder/Transformer	Voltage level	BCU Details		Relay Details	
			Make	Model	Make	Model
1	132 kV Agia	132 kV	GE(ALSTOM)	C264MB1I6910012403000001111N10	ALSTOM	P442216B6M0550K, P14126A6M0500J
2	132 kV Bus Coupler	132 kV	GE(ALSTOM)	C264MB1I691001230200A001111N10	ALSTOM	P14126A6M0500J
3	132 kV Side of 132/33 kV 25 MVA Transformer-1	132 kV	ALSTOM	C264MB1I691001240200A001111N10	ALSTOM	P64222AD6M0040J, P14126A6M0500J
4	132 kV Side of 132/33 kV 25 MVA Transformer-2	132 kV	ALSTOM	C264MB1I691001220200001111N10	ALSTOM	P642226D6M0050P, P14126A6M0500J
5	33 kV Side of 132/33 kV 25 MVA Transformer-1	33 kV	GE(ALSTOM)	C264MB1I6910012303000001111N10	ALSTOM	P14126A6M0500J
6	33 kV Side of 132/33 kV 25 MVA Transformer-2	33 kV	ALSTOM	C264MB1I6910012702000001111N10	ALSTOM	P14126A6M0500J
7	33 kV Damra	33 kV	ALSTOM	C264MB1I691001240200A001111N10	ALSTOM	P14126A6M0500J
8	33 kV Forest Gate	33 kV	GE(ALSTOM)	C264MB1I691001240300A001111N10	ALSTOM	P14126A6M0500J
9	33 kV Baghmara	33 kV	ALSTOM	C264MB1I691001240200A001111N10	ALSTOM	P14126A6M0500J
10	33 kV Mornoi	33 kV	GE(ALSTOM)	C264MB1I691001240200A001111N10	ALSTOM	P14126A6M0510J
11	33 kV Spare-1	33 kV	GE(ALSTOM)	C264MB1I691001240000001111N10	ALSTOM	P14126A6M0500J