



Corrigendum-I

BID IDENTIFICATION NO: AEGCL/MD/Tech-351/O&M(LAR)/Loc 160/DLG-GOSS/Bid

With reference to the above bid document for the work namely "Construction of new tower with pile foundation and associated work in place of river eroded tower at Loc-160 of 132 KV Dhaligaon-Gossaigaon Line" against Bid Identification No. mentioned above, this is to inform that the reference drawings for foundation have been uploaded.

All other terms and conditions of the bidding document remain same.

Sd/-

Chief General Manager (O&M), LAR
Assam Electricity Grid Corporation Ltd
Bijulee Bhawan, Paltanbazar, Guwahati – 01

Memo No. – AEGCL/MD/Tech-351/O&M(LAR)/Loc 160/DLG-GOSS/04
Copy to:


dtd:23.06.25

1. The DGM-IT, O/o the MD, AEGCL, for publication of the corrigendum notice in AEGCL website.
(Soft copy enclosed)
2. Ref. file.

Sd/-

Chief General Manager (O&M), LAR
Assam Electricity Grid Corporation Ltd
Bijulee Bhawan, Paltanbazar, Guwahati – 1

Drawing of Pile foundation for Loc. No.160 of 132 kV DB (+0) Dhaligaon-Gossaigaon Line

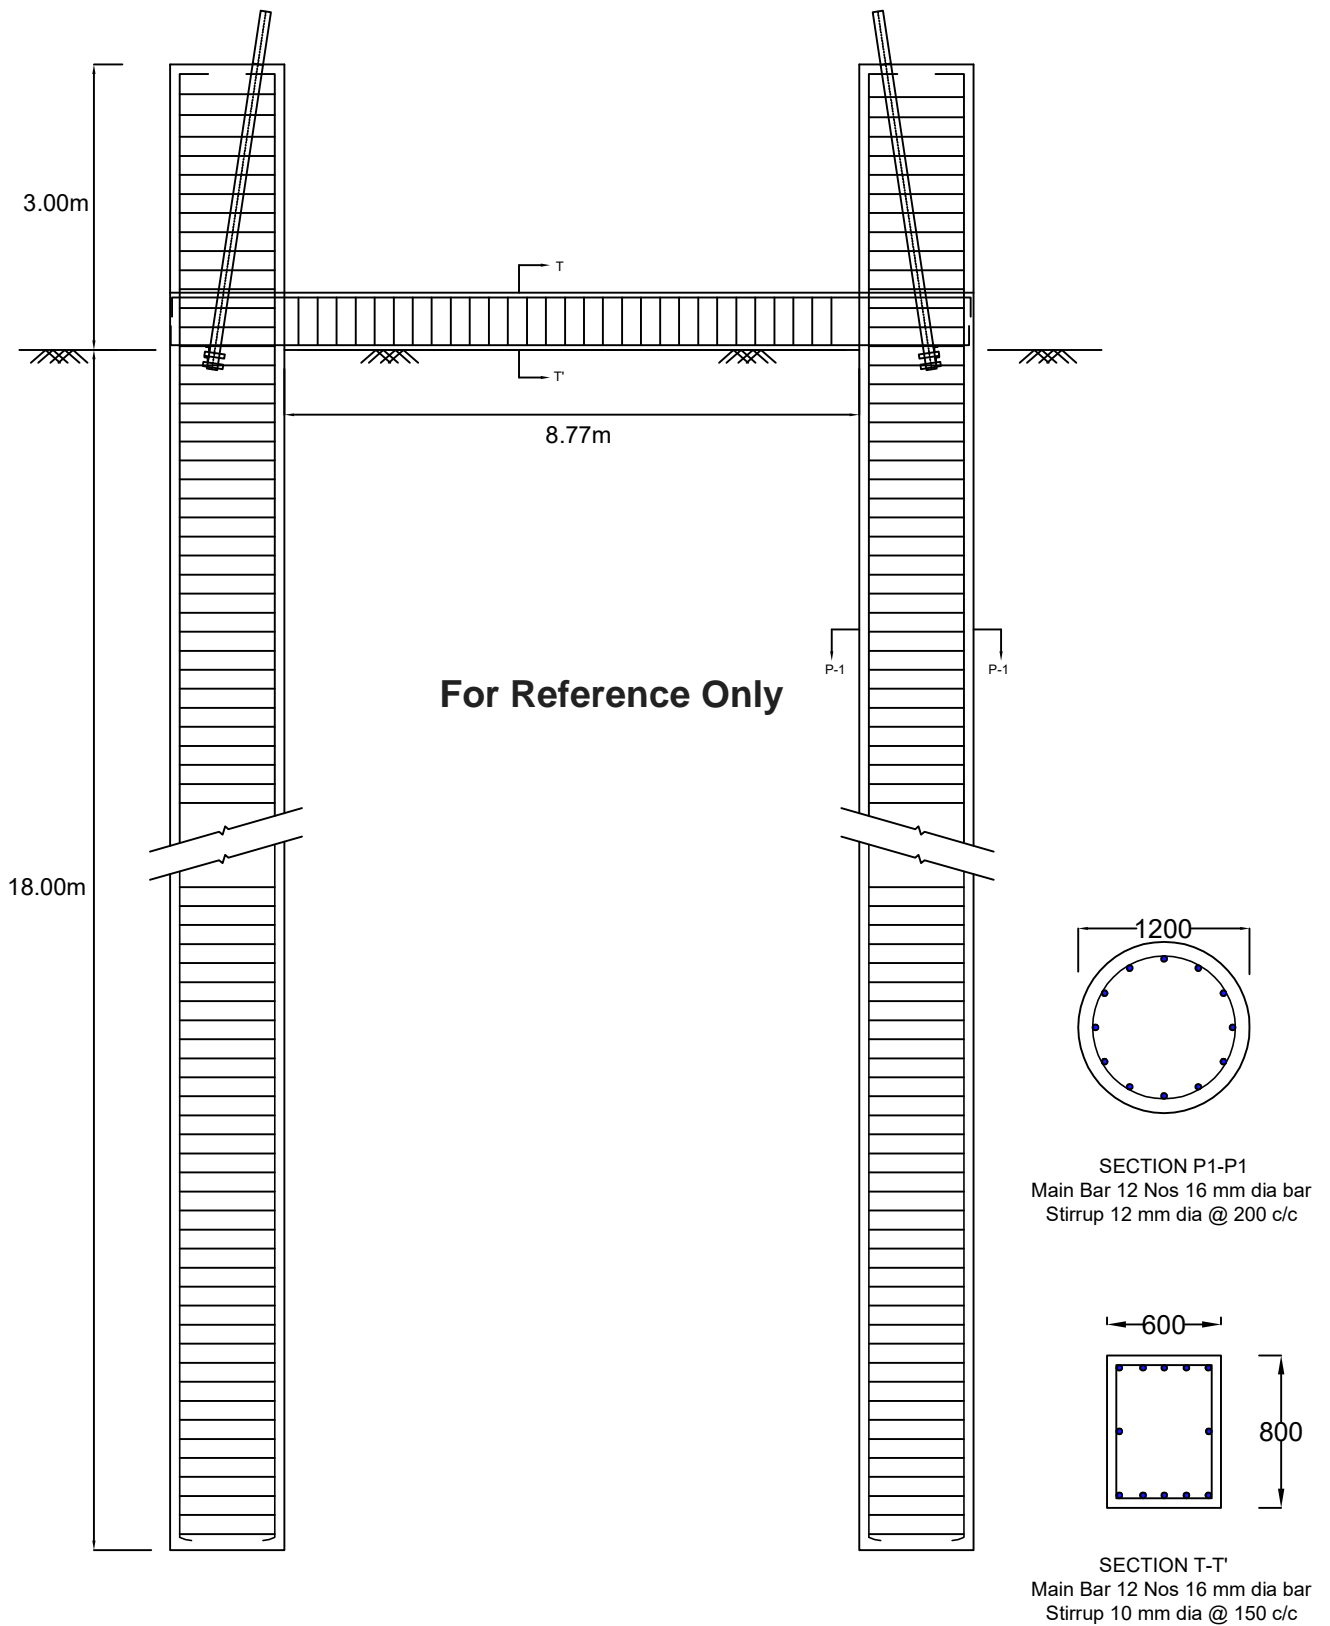

SECTIONAL DETAILS OF PILE

DRAWING NOT TO SCALE
GROUND LEVEL WILL BE AS PER SITE CONDITION
STUB SETTING WILL BE AS PER TOWER TYPE & DRAWING
GRADE OF CONCRETE - M25
GRADE OF STEEL - Fe500
STEEL LINER - 6 mm thick