



THESE PIPE SHALL BE GROUNDED AT PUMP HOUSE THROUGH 75X12mm GI FLAT CONNECTED TO 40mm DIA MS ROD MAIN MAT RUNNING AROUND THE ROOM

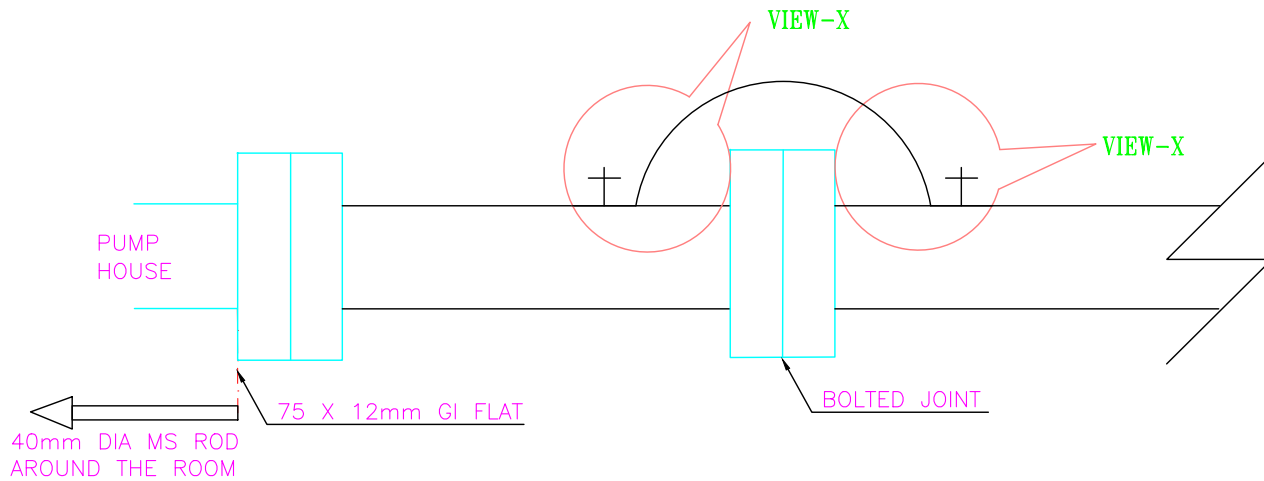

EARTHING OF HYDRANT/HVW SPRAY PIPING

A BOLT SHALL BE WELDED TO THESE STRUCTURE AT THE TIME OF INSTALLATION WHICH CAN BE USED TO CONNECT THEM TO THE NEAREST RISER OR MAIN 40mm DIA MS ROD THROUGH 75X12mm GI FLAT

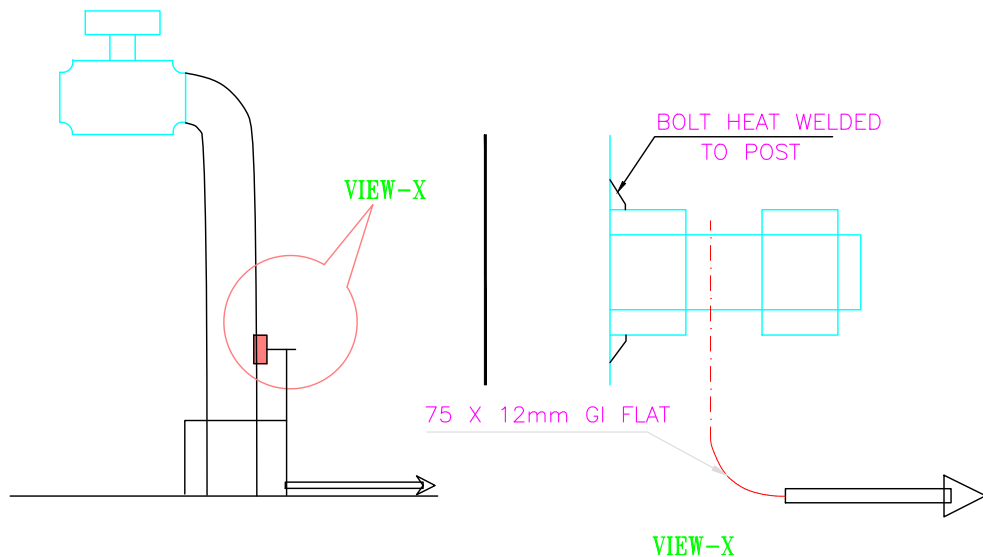

EARTHING OF HYDRANT BOX/HOSE BOX

NOTE:-

1. ALL DIMENSIONS ARE IN mm.
2. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.